


Maximum Recommended Distance	
Amps	Length
100	100'
200	75'
320	40'

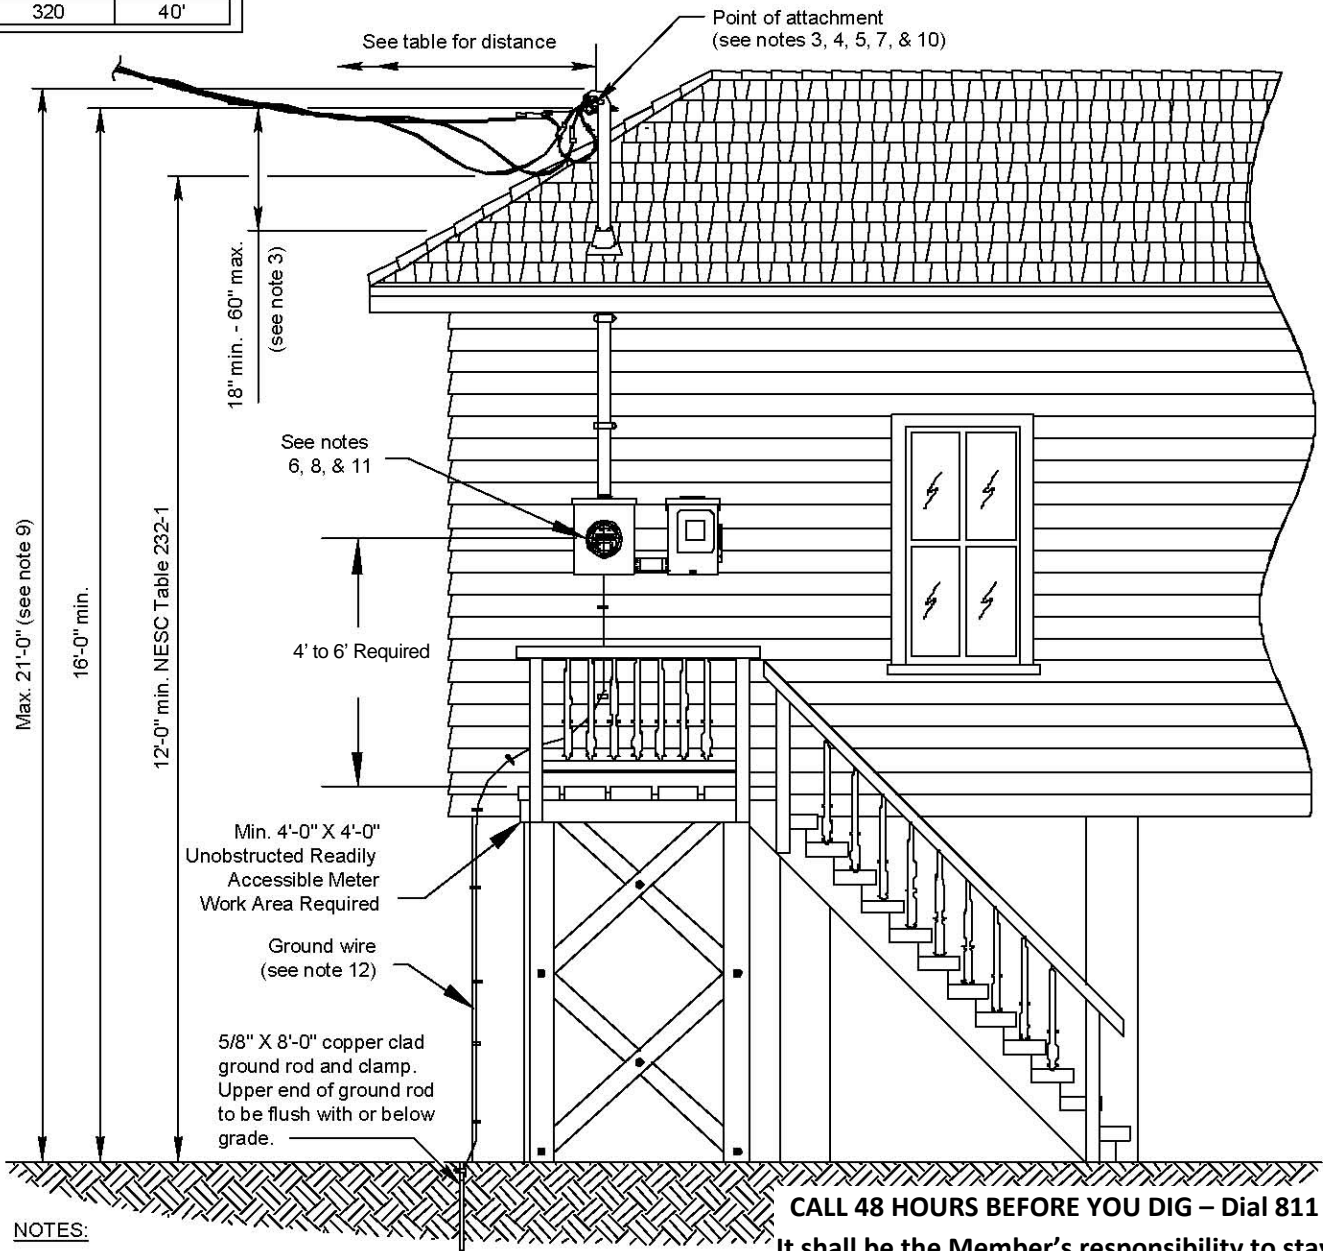

NOTES:

1. Member facilities shall comply with Cooperative Standards, the National Electrical Code, and authorities having jurisdiction.
2. Buildings or other facilities shall not be constructed under existing Cooperative supply lines, nor shall any Cooperative supply lines pass over existing buildings or facilities.
3. Only rigid metal or IMC conduit can be used above the roof.
4. A minimum of 3'-0" of each conductor shall extend from the top of the service mast. The neutral shall be marked with white tape at both ends. Neutral can be bare.
5. Member shall supply and install point of attachment.
6. Main breaker should be within 2'-0" of meter. Outside wall is recommended.
7. Guying or bracing may be required. NEC 230.28.
8. Member shall install meter enclosure.
9. Additional height may be required to maintain clearance. Point of attachment can be no higher than 21'.
10. No telephone or cable attachment allowed on mast. NEC 230.28.
11. Minimum 3 ft. clearance between electric meter and gas meter.
12. For grounding information see section 11.5.
13. Any Service greater than 320 amps, consult the Cooperative.

CALL 48 HOURS BEFORE YOU DIG – Dial 811
It shall be the Member's responsibility to stay clear of all underground facilities.

NOTICE

The Cooperative recommends that all work on the Member's facilities be performed by a qualified, licensed electrical contractor.

TYPICAL FLOOD PLAIN RAISED FOUNDATION METER ACCESS REQUIREMENTS OVERHEAD SOURCE DRAWING 11.7-1

August 2010
 NOT TO SCALE

