




FRONT ELEVATION

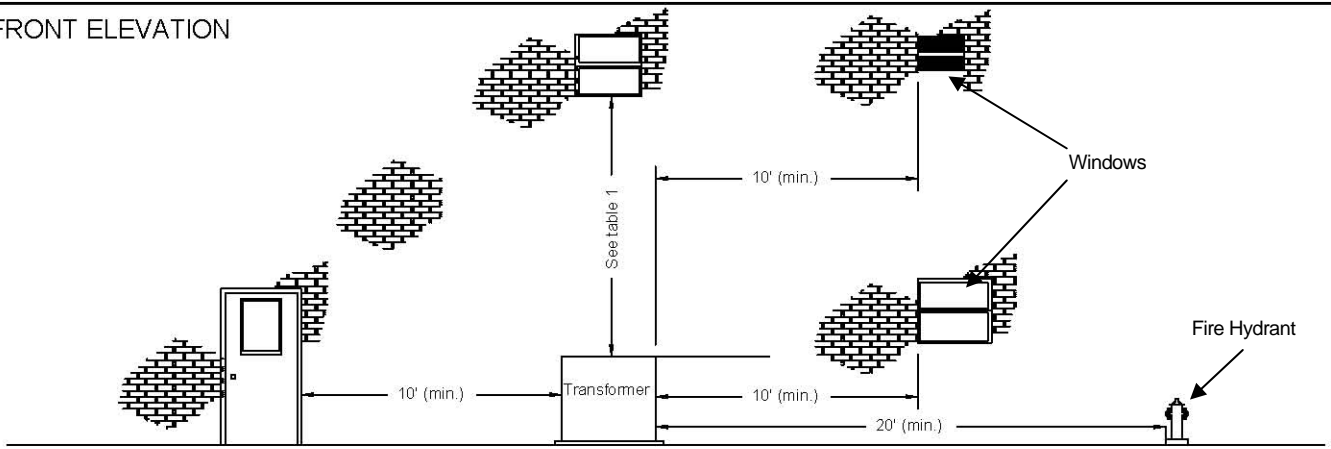


TOP ELEVATION

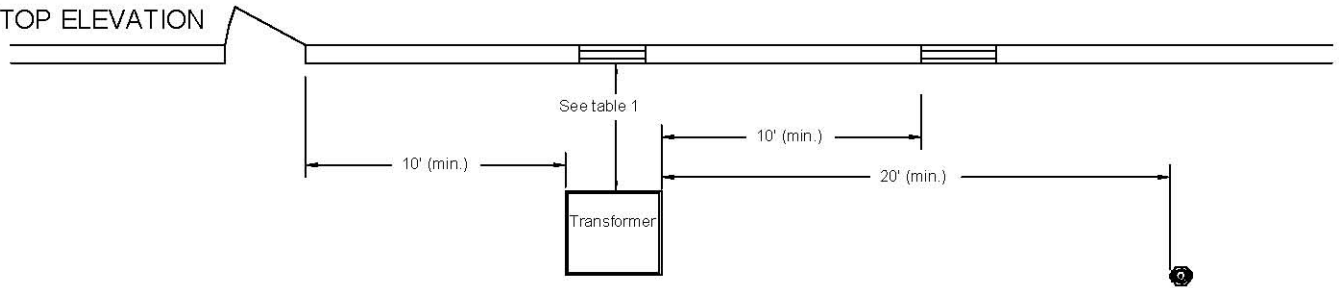

SIDE ELEVATION
OPTION "A1" in Table 1

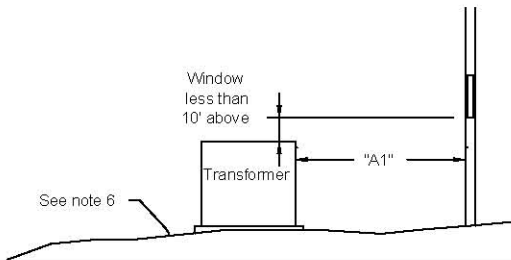

SIDE ELEVATION
OPTION "A2" in Table 1

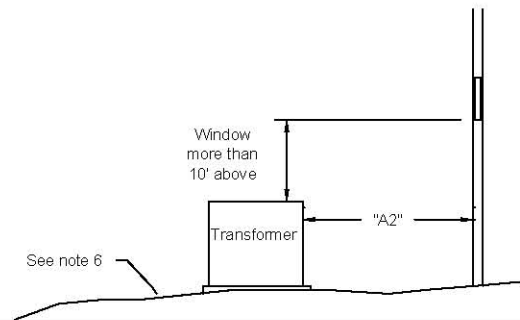

NOTES:

1. The transformer shall be installed so that the front of the unit (hinged opening side) faces away from the building.
2. Adequate passageways to accommodate line trucks or other necessary lifting and hauling equipment shall be provided to allow for maintenance, operation or replacement.
3. No portion of the building shall extend over the transformer.
4. The 20' minimum dimension to the fire hydrant also applies to fire escapes.
5. The 10' minimum dimension to the doorway also applies to open stairways.
6. Drainage of the area surrounding the transformer shall be away from the building.
7. There shall be no above ground obstructions such as cooling towers, shrubs, plants, or fences, within 12' of the front of the transformer pad or within 3' of the sides or back of the transformer pad.
8. It shall be the Member's responsibility to comply with any insurance

NOTICE

The Cooperative recommends that all work on the Member's facilities be performed by a qualified, licensed electrical contractor.

TABLE 1

STRUCTURES	"A1"	"A2"
Steel or Masonry	10'	3'
Wood or Vinyl	10'	10'

**LOCATION OF TRANSFORMERS
AND OTHER OIL FILLED
EQUIPMENT NEAR BUILDINGS**

DRAWING 10.1-1

August 2010
NOT TO SCALE

