


Notes:

1. Member's facilities shall comply with Cooperative Standards, the NEC, and authorities having jurisdiction.
2. Minimum required meter pole clearances:
 - a. Sides of mobile home or other building _____ 10'
 - b. Any direction from gas meter _____ 3'
 - c. Any direction from LP-Gas storage containers _____ 10'
3. No other attachments such as member-owned lighting, basketball goals, satellite dishes, etc. shall be allowed on meter pole.
4. See Drawings 7.1-3 or 7.1-4 for meter pole service construction details.
5. The meter pole shall be located to allow access for Cooperative's heavy trucks without crossing the septic lines, tanks, or lateral field. The member is responsible for marking the location of the septic system to avoid damage from Cooperative vehicles.

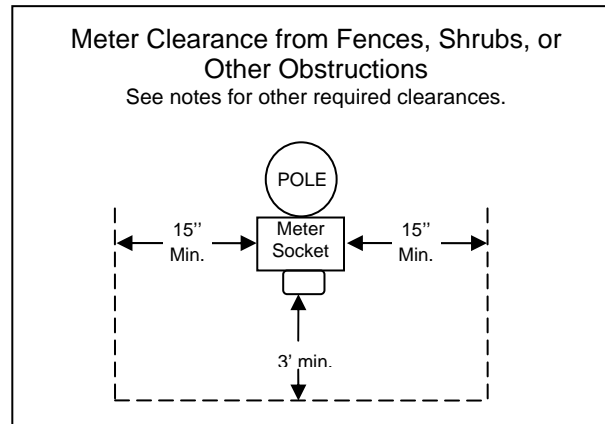

CALL 48 HOURS BEFORE YOU DIG – Dial 811
It shall be the member's responsibility to stay clear of all underground facilities.

Meter Pole Service Location Specifications
DRAWING 4.6-1
 June 2014
 NOT TO SCALE

